


ADAMS BEND

- V -- Water Valve (Apt)
- G -- GAS MAIN
- MS -- Main Sprinkler Valve
- SVB -- Sprinkler Valve Box
- LT -- Exterior light timer
- S -- Sewer Cleanouts
- ST -- Sprinkler Timer
- WM -- Water Main

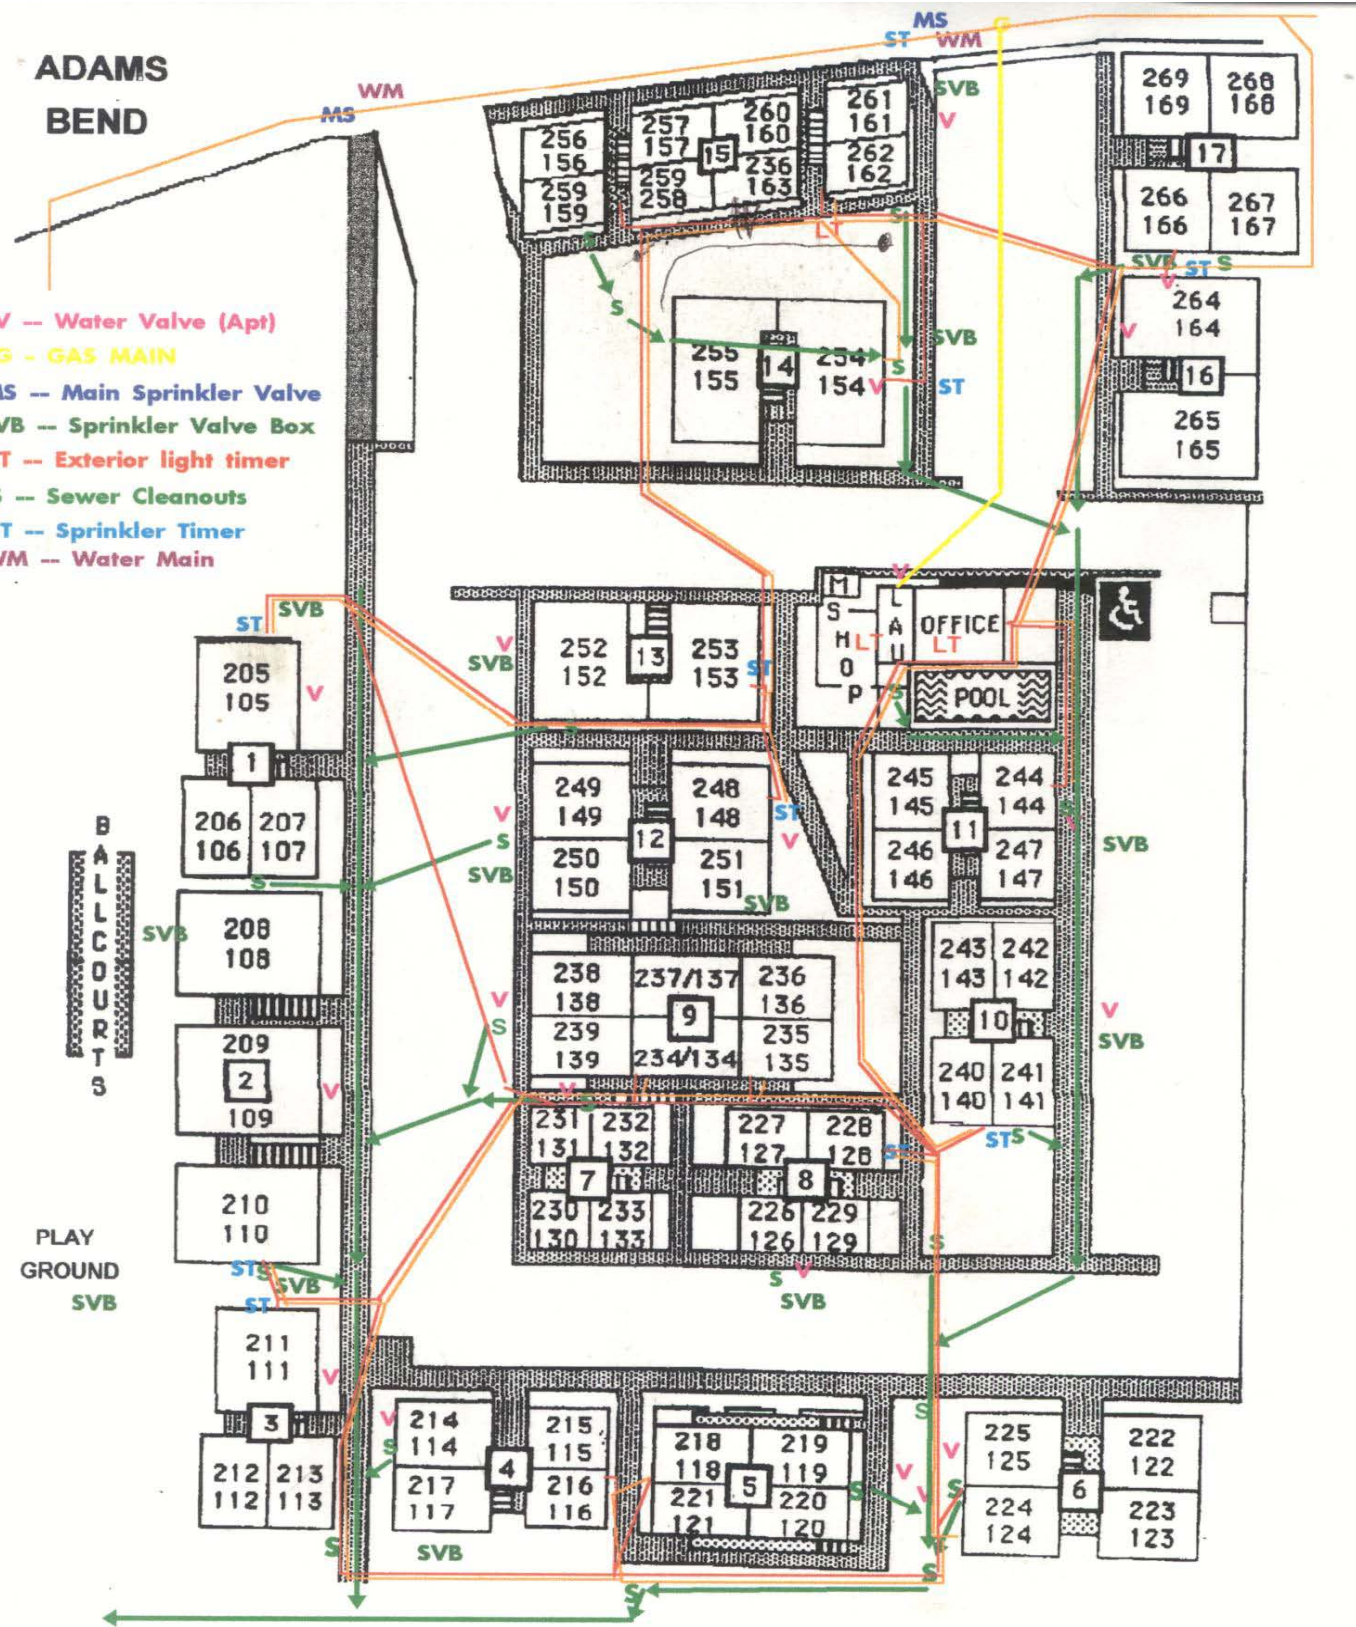

At least one fire extinguisher on every building (Less than 75 feet between each).